


2 Scanning lines & Interlace Factor=3

BS

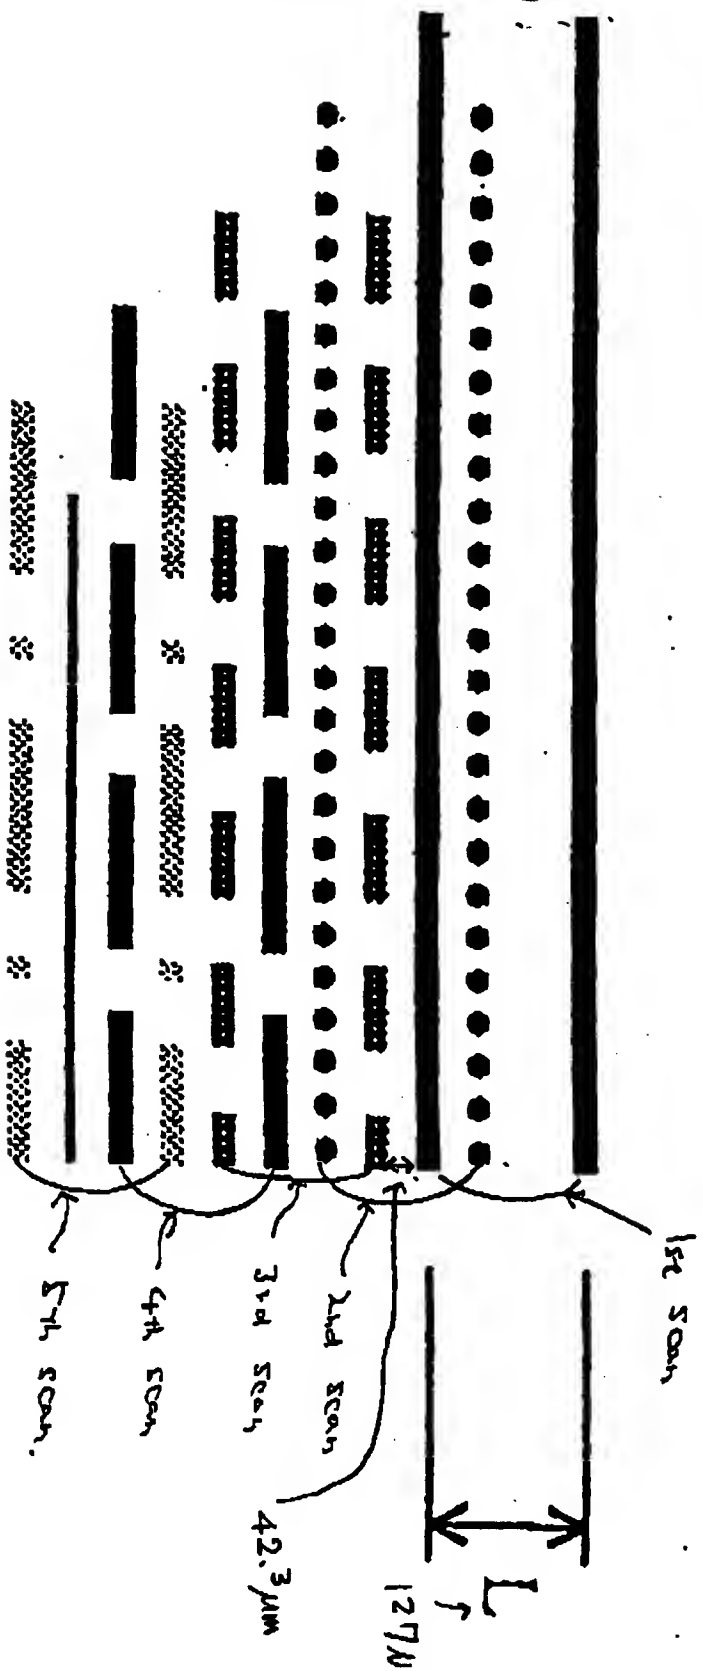

APPENDIX A